




INVESTMENT PROJECT PROFILE

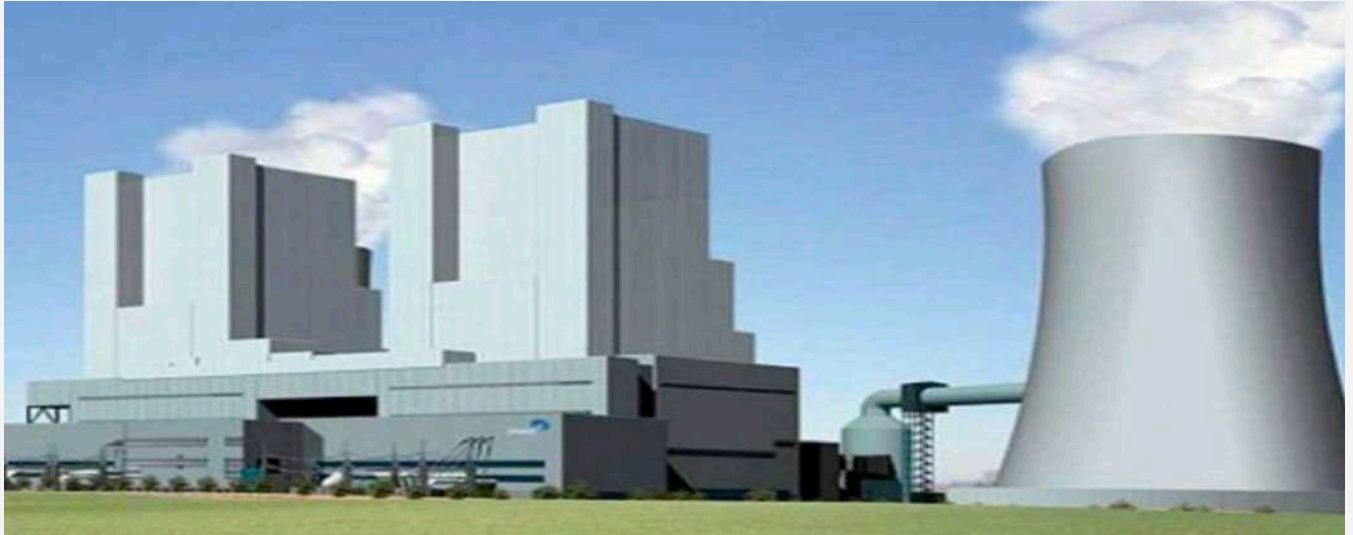

Location	Municipality of Bugojno, nearby to the Kotezi coal mine
Type	TPP – Restructuring of Gracanica coal mine Cogeneration unit with coal burning
Fuel	Coal Lignite / Hd= 10.600 kJ/kg Consumption 2.1 million t/year
Installed net electric power	app. 350 MW
Installed net thermal power	app. 800 MW
Efficiency in condensing mode	40%
Emission Limit values	
NOx	<200 mg/Nm ³
SO2	<200 mg/Nm ³
Dust	<30 mg/Nm ³
Total investment cost (including coal mine upgrade)	592.57 million EUR
Approvals status	Gracanica Coal Mine has a license to explore
Investment & Technical documentation status	Feasibility study for TPP and coalmine completed
Project schedule	2017-2022

For additional information about this project, please contact by e-mail: info@coral-consulting-service.com